

# Annual Report

Balmertown, Cochenour & McKenzie Island  
Drinking Water System



# 2025

Prepared by **Northern Waterworks Inc.**  
on behalf of the **Municipality of Red Lake**



# Contents

- 1 Introduction .....3**
  - 1.1 Annual Reporting Requirements ..... 3**
  - 1.2 Report Availability ..... 3**
- 2 System Overview & Expenses.....4**
  - 2.1 System Description ..... 4**
  - 2.2 Water Treatment Chemicals ..... 5**
  - 2.3 System Expenses ..... 6**
- 3 Water Quality.....7**
  - 3.1 Overview ..... 7**
  - 3.2 Microbiological Parameters ..... 7**
  - 3.3 Operational Parameters ..... 8**
  - 3.4 Conventional Filtration Performance ..... 9**
  - 3.5 Nitrate & Nitrite ..... 10**
  - 3.6 Trihalomethanes & Haloacetic Acids ..... 10**
  - 3.7 Lead Sampling ..... 11**
  - 3.8 Environmental Discharge Sampling..... 13**
  - 3.9 Inorganic & Organic Parameters ..... 14**
  - 3.10 Harmful Algal Bloom Monitoring ..... 16**
- 4 Water Production .....17**
  - 4.1 Overview ..... 17**
  - 4.2 Flow Monitoring Results ..... 17**
  - 4.3 Recent Historical Flows..... 20**
- 5 Compliance .....21**
  - 5.1 Overview ..... 21**
  - 5.2 Adverse Water Quality Incidents ..... 21**
  - 5.3 Regulatory Compliance..... 21**

# 1 Introduction

## 1.1 Annual Reporting Requirements

This consolidated Annual Report (the Report) has been prepared in accordance with both section 11 (Annual Reports) and Schedule 22 (Summary Reports for Municipalities) of Ontario Regulation 170/03 (Drinking Water Systems Regulation). This Report is intended to inform both the public and Municipal Council about the operation of the system over the previous calendar year (January 1 to December 31, 2025).

Section 11 of O. Reg. 170/03 requires the development and distribution to the public of an annual report summarizing water quality monitoring results, adverse water quality incidents, system expenses and chemicals used in the water treatment process.

Schedule 22 of O. Reg. 170/03 requires the development and distribution to Council of an annual report summarizing incidents of regulatory non-compliance and associated corrective actions, in addition to providing flow monitoring results for the purpose of enabling the Owner to assess the capability of the system to meet existing and planned demand.

## 1.2 Report Availability

In accordance with section 11 of O. Reg. 170/03, this Report must be given, without charge, to every person who requests a copy. Effective steps must also be taken to advise users of water from the system that copies of the report are available, without charge, and of how a copy may be obtained. This Annual Report shall be made available for inspection by the public at the Red Lake Municipal Office and on the Municipality's website.

In accordance with Schedule 22 of O. Reg. 170/03, this Report must be given to the members of Municipal Council. Section 19 (Standard of care, municipal drinking-water system) of Ontario's *Safe Drinking Water Act* (SDWA) also places certain responsibilities upon those municipal officials who oversee an accredited operating authority or exercise decision-making authority over a system. The examination of this Report is one of the methods by which municipal officials may fulfil the obligations required by section 19 of the SDWA.

System users and members of Council should contact a representative of NWI for assistance in interpreting this Report. Questions and comments may be directed to the local NWI Operations Manager or by email to [compliance@nwi.ca](mailto:compliance@nwi.ca).

## 2 System Overview & Expenses

### 2.1 System Description

The Balmertown, Cochenour & McKenzie Island (BCMI) Drinking Water System must meet extensive treatment and testing requirements to ensure that human health is protected. The operation and maintenance of the system is governed by Ontario's *Safe Drinking Water Act* and the regulations therein, in addition to requirements within system-specific environmental approvals. Important system information is summarized in Table 1.

Drinking-Water System Name:	Balmertown, Cochenour & McKenzie Island (BCMI) Drinking Water System
DWS Number:	210000522
DWS Category:	Large Municipal Residential
DWS Owner:	The Corporation of the Municipality of Red Lake
DWS Operating Authority:	Northern Waterworks Inc.
DWS Components:	<ul style="list-style-type: none"> <li>• Raw water pumping station</li> <li>• Cochenour Water Treatment Plant</li> <li>• Balmertown Reservoir Pumping Station</li> <li>• Cochenour &amp; McKenzie Island water distribution system</li> <li>• Balmertown water distribution system</li> </ul>
Treatment Processes:	<ul style="list-style-type: none"> <li>• Chemical coagulation, flocculation and clarification</li> <li>• Dual media (rapid sand) filtration</li> <li>• Free chlorine disinfection</li> <li>• pH adjustment</li> </ul>

Water production begins as raw water flows by gravity from the intake structure located in Bruce Channel (Red Lake) and into an underground reservoir located at the raw water pumping station. Pumps at the station transfer water from the reservoir and through a transmission line directly to the treatment units at the Cochenour Water Treatment Plant. Aluminum sulphate (coagulant) and sodium carbonate solution (pH/alkalinity adjustment) are injected and rapidly mixed into the raw water immediately upstream from the three package treatment units, which each include a two-stage flocculation tank, clarifier and filter.

To promote floc formation water is gently mixed as it passes through the flocculation basins. Polymer solution (flocculant) is also added to the water at this stage of treatment to form larger and more stable floc aggregates. Process water then enters the clarifier where its velocity is reduced to allow for the separation and settling of floc. Supernatant overflows into the clarifier effluent launders and is directed to the filter unit; settled floc (sludge) is automatically removed from the bottom of the clarifier.

Impurities that were not captured and settled as floc in the clarifier are removed by passing water through a dual media filter composed of anthracite and silica sand. Chlorine gas (disinfectant) and sodium carbonate solution are added to the filtrate as it is directed from the filters to the treated water storage reservoir. The filters are periodically cleaned by using an air scour to agitate the entire media bed and reversing the flow of water through the filter.

A majority of the water produced is transferred through a transmission line from the Cochenour Water Treatment Plant (WTP) to the reservoir at the Balmertown Reservoir Pumping Station (RPS). Primary disinfection is achieved as disinfectant mixes with the water in the reservoirs at both facilities. Pumps located at the Balmertown RPS and Cochenour WTP then transfer treated water from the facility reservoirs to the Balmertown and Cochenour/McKenzie Island water distribution systems, respectively. Secondary disinfection requirements in the distribution systems are achieved by maintaining a free chlorine residual at all locations.

## 2.2 Water Treatment Chemicals

In accordance with section 11 of O. Reg. 170/03, this Report must include a list of all water treatment chemicals used by the system during the period covered by the report (summarized in Table 2). All chemicals used in the treatment process are NSF/ANSI 60 certified for use in potable water, as required by system approvals.

Treatment Chemical	Application
aluminum sulphate	coagulant
sodium carbonate	pH/alkalinity adjustment
polymer (Polyfloc CP1160P)	flocculant
chlorine gas	disinfectant



### 2.3 System Expenses

In accordance with section 11 of O. Reg. 170/03, this Report must describe any major expenses incurred during the reporting period to install, repair, or replace required equipment. This Report also summarizes those expenses related to strengthening equipment inventories and to maintenance activities undertaken by subcontracted service providers. Major expenses incurred in 2025 are summarized in Table 3.

**Table 3: Major expenses incurred in 2025 (BCMI DWS)**

Category	Description	Expense
Maintenance	Back flow verification testing	\$1,275
Maintenance	Generators repairs and servicing	\$4,464
Maintenance	Flow meter calibration verifications	\$2,000
Maintenance	Fire extinguisher testing	\$273
Repairs	Keystone actuator valve replacement	\$3,181
Maintenance	Trans Canada Safety Gas detector	\$319

### 3 Water Quality

#### 3.1 Overview

Water quality monitoring is conducted to determine and confirm that drinking water delivered to the consumer is safe and aesthetically pleasing. Monitoring is also required to assess compliance with legislation and to control the treatment process. In accordance with section 11 of O. Reg. 170/03, this Report must summarize the results of water quality tests required by regulations, approvals, and orders. The following sections summarize the results of all required water quality tests and compare the results to applicable water quality standards.

#### 3.2 Microbiological Parameters

Microbiological sampling and testing requirements are provided in Schedule 10 (Microbiological sampling and testing) of O. Reg. 170/03. In 2025, a total of 318 routine source, treated and distribution water samples were collected for microbiological analysis by an accredited laboratory. Samples were collected on a weekly basis and included tests for E. coli (EC), total coliforms (TC) and heterotrophic plate counts (HPC). Results from microbiological analyses are summarized in Table 4. All results were below the associated Ontario Drinking Water Quality Standards.

Sample Type	# of Samples	EC Results Range <sup>1</sup> (MPN/100mL)	TC Results Range <sup>1</sup> (MPN/100mL)	# of HPC Samples	HPC Results Range (CFU/mL)
Raw Water	53	0 to 2	0 to 125	---	---
Treated Water (CWTP)	53	absent	absent	53	0 to 5
Balmertown (BRPS)	53	absent	absent	52	0 to 8
Distribution (routine)	159	absent	absent	53	0 to 6
Distribution (nonroutine)	0	NR	NR	---	---

1. The Ontario Drinking Water Quality Standard for E. Coli and Total Coliforms in a treated or distribution sample is 'not detectable'. The presence of either parameter in a treated or distribution sample constitutes an exceedance..

### 3.3 Operational Parameters

In accordance with Schedule 7 (Operational checks) of O. Reg. 170/03, regulated operational parameters that must be monitored include raw water turbidity, filtrate turbidity and the free chlorine residuals associated with primary and secondary disinfection. Table 5 summarizes water quality results for regulated and selected unregulated operational parameters. In accordance with Schedule 6 (Operational checks, sampling, and testing – general) of O. Reg. 170/03, certain operational parameters are continuously monitored. No Adverse Water Quality Incidents (AWQIs) pertaining to operational parameters occurred during the reporting period.

**Table 5:** Results summary for operational parameters

Parameter (Sample Type) <sup>1</sup>	Number of Samples	Units	Min. Result	Max. Result	Annual Avg.	Adverse Result
Turbidity (Raw Water)	77	NTU	0.45	1.84	0.76	n/a
Turbidity (Filter 1)	Continuous	NTU	0.010	0.155	0.052	>1.0
Turbidity (Filter 2)	Continuous	NTU	0.026	0.119	0.045	>1.0
Turbidity (Filter 3)	Continuous	NTU	0.040	0.294	0.067	>1.0
Turbidity (Treated)	365	NTU	0.09	0.24	0.14	n/a
pH (Treated)	365	---	7.1	7.68	7.36	n/a
Alkalinity (Treated)	229	mg/L	31.7	57.9	45.6	n/a
Aluminum Residual (Treated)	244	mg/L	0.013	0.046	0.029	n/a
FCR (Treated - CWTP) <sup>2</sup>	Continuous	mg/L	1.36	2.85	1.82	n/a
FCR (Treated - BRPS) <sup>2</sup>	Continuous	mg/L	0.44	2.02	0.44	n/a
FCR (CMI Distribution) <sup>3</sup>	350+	mg/L	0.52	1.85	n/a	<0.05
FCR (Balm. Distribution) <sup>3</sup>	400+	mg/L	0.52	2.02	n/a	<0.05

1. FCR = free chlorine residual; CMI = Cochenour & McKenzie Island; Balm. = Balmertown.
2. There is no adverse result corresponding to the treated water free chlorine residual. However, an observation of adverse water quality occurs if the residual is low enough such that water has not been disinfected in accordance with the system's *Municipal Drinking Water Licence*.
3. Free chlorine residuals are tested at various locations in the distribution systems. The free chlorine residual varies with water age and distribution system location, and the values in the table pertain to the minimum and maximum results collected across all locations in the calendar year.

### 3.4 Conventional Filtration Performance

In accordance with the system's *Municipal Drinking Water Licence*, conventional filtration facilities must meet certain performance criteria in order to claim removal credits for *Cryptosporidium* oocysts and *Giardia* cysts. In addition to continuously monitoring filtrate turbidity and other requirements, filtrate turbidity must be less than or equal to 0.3 NTU in at least 95% of the measurements each month. Table 6 summarizes filtrate turbidity compliance against the <0.3 NTU/95% performance criterion. Minimum and maximum values in the table correspond to the proportion of time that filtered water turbidity was less than or equal to 0.3 NTU in a calendar month in 2025. No AWQIs related to conventional filtration performance occurred during the reporting period.

**Table 6:** Filtration performance summary

Filter	Minimum Result	Maximum Result	Adverse Result
Filter 1	100%	100%	<95%
Filter 2	100%	100%	<95%
Filter 3	100%	100%	<95%



### 3.5 Nitrate & Nitrite

Treated water is tested for nitrate and nitrite concentrations on a quarterly basis in accordance with Schedule 13 (Chemical sampling and testing) of O. Reg. 170/03. Nitrate and nitrite results are provided in Table 7. All results were below the Ontario Drinking Water Quality Standards.

Sample Date	Nitrate		Nitrite	
	Result (mg/L)	ODWQS (mg/L)	Result (mg/L)	ODWQS (mg/L)
18-Feb-2025	0.095	10	<0.010	1
14-May-2025	0.071		<0.010	
18-Aug-2025	<0.020		<0.010	
12-Nov-2025	0.045		<0.010	

### 3.6 Trihalomethanes & Haloacetic Acids

Trihalomethanes (THMs) and haloacetic acids (HAAs) are sampled on a quarterly basis from a distribution system location that is likely to have an elevated potential for their formation, in accordance with Schedule 13 (Chemical sampling and testing) of O. Reg. 170/03. Total THM and HAA results are provided in Table 8 and Table 9, respectively. Compliance with the provincial standards for THM and HAA concentrations is determined by calculating a running annual average (RAA) each quarter. The 2025 RAAs for THMs were below the Ontario Drinking Water Quality Standards.

Sample Date	Result (µg/L)	Quarterly Average (µg/L)
11-Feb-25	50.2	50.2
Q1 Regulatory Average (RAA)		77.3
13-May-25	51.6	51.6
Q2 Regulatory Average (RAA)		74.2
11-Aug-25	115	113
21-Aug-25	111	
Q3 Regulatory Average (RAA)		77.2
12-Nov-25	90.2	90.2
Q4 Regulatory Average (RAA)		76.3

ODWQS (RAA)		100
-------------	--	-----

Zero (0) AWQIs were reported for an HAA exceedance in 2025. Samples were taken more frequently than required to continue to monitor the levels more closely after ongoing AWQIs were resolved at the end of Q4 2023 with a return to quarterly sampling in Q4 of 2025 We will return to quarterly sampling in 2026.

**Table 9: Total HAA results**

Sample Date	Result (µg/L)	Quarterly Average Result (µg/L)
27-Jan-25	69.3	62.2
18-Feb-25	55.0	
Q1 Regulatory Average (RAA)		69.5
7-Apr-25	70.0	63.6
14-May-25	57.2	
Q2 Regulatory Average (RAA)		69.6
14-Jul-25	72.0	90.2
11-Aug-25	98.5	
21-Aug-25	94.9	
22-Sep-25	95.4	
Q3 Regulatory Average (RAA)		70.4
12-Nov-25	72.0	72.0
Q4 Regulatory Average (RAA)		72.7
ODWQS (RAA)		80

### 3.7 Lead Sampling

Based upon favourable sampling results in the community, the BCMI DWS previously qualified for reduced lead sampling and ultimately became exempt from sampling at plumbing locations in accordance with Schedule 15.1 (Lead) of O. Reg. 170/03. Two (2) distribution system samples must now be collected and analyzed for pH and alkalinity during the two lead sampling periods. Additionally, these distribution system samples must be analyzed for lead in every third 12-month period after the plumbing sample exemption was activated. Table 10 summarizes the results of community lead sampling and related required tests.

**Table 10:** Distribution pH, alkalinity, and lead sampling results

Sample Date	Distribution Sampling Location	pH	Alkalinity (mg/L)	Lead Result <sup>1</sup> (µg/L)
8-Apr-2024	Cochenour Crescent Valve	7.53	45.7	<1.0
8-Apr-2024	Cochenour Crescent Valve	7.53	45.7	<1.0
8-Apr-2024	Balmertown Waste Plant	7.39	44.8	2.3
8-Apr-2024	Balmertown Waste Plant	7.39	44.8	1.7
12-Sep-2024	Cochenour Crescent Valve	7.42	45.8	<1.0
12-Sep-2024	Cochenour Crescent Valve	7.42	45.8	<1.0
12-Sep-2024	Balmertown WPCP Hydrant	7.3	45.2	<1.0
12-Sep-2024	Balmertown WPCP Hydrant	7.3	45.2	<1.0
27-May-2025 <sup>3</sup>	Balmertown WPCP Hydrant 1	7.2	40.8	lead analyses not required <sup>2</sup>
27-May-2025 <sup>3</sup>	McMarmac Bleeder	7.4	45	
8-Oct-2025	Balmertown WPCP Hydrant 1	7.37	46.2	<1.0 <sup>2</sup>
8-Oct-2025	28 Edward Ave Hydrant 16	7.56	58.2	<1.0 <sup>2</sup>

1. The Ontario Drinking Water Quality Standard for lead in drinking-water is 10 µg/L.
2. Distribution samples were last required to be collected and tested for lead during Summer 2024 sampling period and will begin again in Winter 2026-27 sampling period.
3. Sampling was completed after the regulatory sampling period of Dec 15- April 15 . The Ministry was notified of this non-compliance.



### 3.8 Environmental Discharge Sampling

The *Municipal Drinking Water Licence* for the BCMI Drinking Water System requires additional sampling associated with discharges to the natural environment. Specifically, samples must be collected from settling tank effluent on a monthly basis and tested for the parameter total suspended solids (TSS). This effluent is discharged to Bruce Channel and originates from the onsite treatment of the wastewater produced during plant operation. The *Licence* also requires that the effluent discharged to the environment has an annual average TSS concentration below 25 mg/L. Table 11 summarizes 2025 environmental discharge sampling results.

**Table 11:** Environmental discharge sampling results summary

Number of Samples	Minimum TSS Result (mg/L)	Maximum TSS Result (mg/L)	TSS Annual Average (mg/L)
12	<3.0	7.9	5.0



### 3.9 Inorganic & Organic Parameters

Most inorganic parameters are sampled on an annual basis in treated water in accordance with Schedules 13 (Chemical sampling and testing) and 23 (Inorganic parameters) of O. Reg. 170/03. The inorganic parameters sodium and fluoride are sampled every five (5) years in treated water in accordance with Schedules 13 and 23 of O. Reg. 170/03. The most recent inorganic parameter sampling results are provided in Table 12. All results were below the associated Ontario Drinking Water Quality Standards.

Parameter	Most Recent Sample Date	Units	Result	ODWQS
Antimony	11-Aug-2025	µg/L	<0.60	6
Arsenic	11-Aug-2025	µg/L	<1.0	10
Barium	11-Aug-2025	µg/L	<10	1000
Boron	11-Aug-2025	µg/L	<50	5000
Cadmium	11-Aug-2025	µg/L	<0.10	5
Chromium	11-Aug-2025	µg/L	<1.0	50
Fluoride	13-Feb-2023	mg/L	<0.020	1.5
Mercury	11-Aug-2025	µg/L	<0.100	1
Selenium	11-Aug-2025	µg/L	<1.0	50
Sodium	13-Feb-2023	mg/L	24.3 <sup>1</sup>	20
Uranium	11-Aug-2025	µg/L	<2.0	20

1. The parameter sodium is not considered a toxic element and is not associated with a Standard as prescribed in O. Reg. 169/03, although an exceedance of 20 mg/L requires reporting and corrective actions. The result in the table was reported as an Adverse Water Quality Incident. See the *Compliance* section of the 2023 annual report for more information.

Organic parameters are sampled on an annual basis in treated water in accordance with Schedules 13 (Chemical sampling and testing) and 24 (Organic parameters) of O. Reg. 170/03. These parameters include various organic acids, pesticides, herbicides, PCBs, volatile organics, and other chemicals. Sampling for all organic parameters was conducted on August 11, 2025, and results are provided in Table 13. All results were below the associated Ontario Drinking Water Quality Standards.

**Table 13: Organic parameter sampling results**

Parameter	Result (µg/L)	ODWQS (µg/L)	Parameter	Result (µg/L)	ODWQS (µg/L)
Alachlor	<0.050	5	Diuron	<0.050	150
Atrazine & Metabolites	<0.14	5	Glyphosate	<1.0	280
Azinphos-methyl	<0.100	20	Malathion	<0.025	190
Benzene	<0.50	1	MCPA	<0.00020	100
Benzo(a)pyrene	<0.005	0.01	Metolachlor	<0.025	50
Bromoxynil	<0.200	5	Metribuzin	<0.10	80
Carbaryl	<0.050	90	Monochlorobenzene	<0.50	80
Carbofuran	<0.0250	90	Paraquat	<1.0	10
Carbon Tetrachloride	<0.20	2	Pentachlorophenol	<0.50	60
Chlorpyrifos	<0.10	90	Phorate	<0.25	2
Diazinon	<0.025	20	Picloram	<0.10	190
Dicamba	<0.10	120	Total PCBs	<0.030	3
1,2-Dichlorobenzene	<0.50	200	Prometryne	<0.025	1
1,4-Dichlorobenzene	<0.50	5	Simazine	<0.10	10
1,2-Dichloroethane	<0.50	5	Terbufos	<0.50	1
1,1-Dichloroethylene	<0.50	14	Tetrachloroethylene	<0.50	10
Dichloromethane	<1.0	50	2,3,4,6-Tetrachlorophenol	<0.50	100
2,4-Dichlorophenol	<0.20	900	Triallate	<0.10	230
2,4-D	<0.050	100	Trichloroethylene	<0.50	5
Diclofop-methyl	<0.10	9	2,4,6-Trichlorophenol	<0.20	5
Dimethoate	<0.050	20	Trifluralin	<0.10	45
Diquat	<1.0	70	Vinyl Chloride	<0.20	1

### 3.10 Harmful Algal Bloom Monitoring

Starting in 2022 a requirement was added to the Municipal Drinking Water License to monitor for Harmful Algae Blooms. If a bloom is identified or suspected, then microcystin testing must be undertaken. According to the HAB plan sampling must continue for three (3) weeks of no microcystin identified. There were zero (0) reported or suspected blooms during the standard monitoring period in 2025.

There were also no suspected or occurring HABs outside the standard period of June 1 to October 31. Historic sample results have consistently identified no microcystin in raw or treated water when algal blooms are observed. Table 14 provides a summary of suspected or occurring HABs in Hudson since monitoring began.

Table 14: Recent historical algal bloom summary		
Year	Suspected	Harmful Algal Blooms
2022	0	0
2023	0	0
2024	0	0
2025	0	0


## 4 Water Production

### 4.1 Overview

In accordance with Schedule 22 (Summary Reports for Municipalities) of O. Reg. 170/03, this Annual Report must include certain information for the purpose of enabling the Owner to assess the capability of the system to meet existing and planned uses. Specifically, this Report must include a summary of the quantities and flow rates of the water supplied during the reporting period, including monthly average and maximum daily flows. The Report must also include a comparison of flow monitoring results to the rated capacity and flow rates approved in the system's *Municipal Drinking Water Licence*.

### 4.2 Flow Monitoring Results

Throughout the reporting period the BCMI DWS operated within its rated capacity and supplied a total of 280,432 m<sup>3</sup> of treated water. On an average day in 2025, 706 m<sup>3</sup> of treated water was supplied to the communities of Balmertown, Cochenour & McKenzie Island, which represents 12% of the rated capacity of the Cochenour Water Treatment Plant (6,065 m<sup>3</sup>/day). The maximum daily flow in 2025 was 1,679 m<sup>3</sup>/day, which represents 28% of the rated capacity of the treatment facility. Flow monitoring results are summarized in Figure 1 and Table 15. The capacity assessments provided in the table compare the average and maximum daily treated water flows to the rated capacity of the treatment facility.

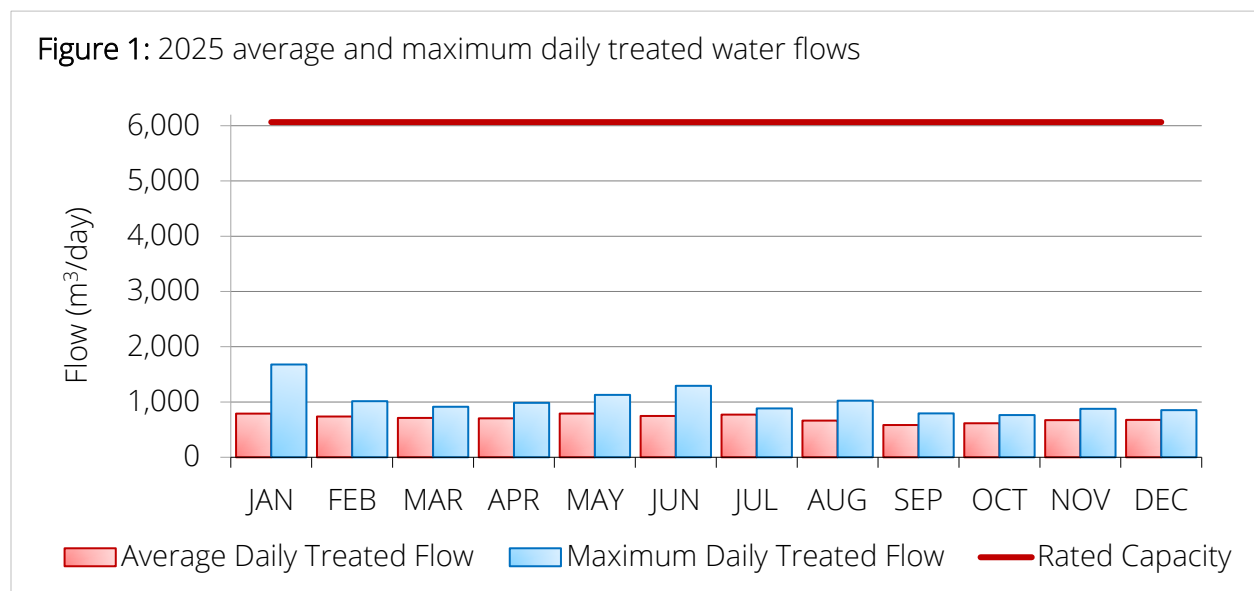

**Table 15: 2025 water production summary**

Month	Total Volumes (m <sup>3</sup> )		Daily Flows (m <sup>3</sup> /day)		Capacity Assessments	
	Raw Water	Treated Water	Average - Treated	Maximum - Treated	Average - Treated	Maximum - Treated
Jan	29,602	24,493	790	1,679	28%	28%
Feb	25,296	20,652	738	1,015	17%	17%
Mar	28,690	22,071	712	914	15%	15%
Apr	27,706	21,137	705	985	16%	16%
May	31,642	24,529	791	1,129	19%	19%
Jun	26,710	22,427	748	1,293	21%	21%
Jul	29,052	23,933	772	884	15%	15%
Aug	24,784	20,574	664	1,024	17%	17%
Sep	22,536	17,508	584	794	13%	13%
Oct	23,270	19,080	615	764	13%	13%
Nov	24,734	20,160	672	877	14%	14%
Dec	25,244	20,303	677	853	14%	14%
Total	319,266	256,867	---	MAX:	---	---
Average	26,606	21,406	706	1,679	12%	28%

Over the reporting period, 77% (198,549) of the total amount of treated water produced was distributed to the community of Balmertown, with the remaining 23% (58,318 m<sup>3</sup>) being distributed to the communities of Cochenour and McKenzie Island. On an average day in 2025, 544 m<sup>3</sup> of treated water was supplied to Balmertown and 160 m<sup>3</sup> was supplied to Cochenour & McKenzie Island. Table 16 provides a summary of flow monitoring results organized by the respective water distribution systems.

**Table 16: 2025 water production summary – results by water distribution system**

Month	Balmertown			Cochenour & McKenzie Island		
	Total Volume (m <sup>3</sup> )	Average Daily Flow (m <sup>3</sup> /day)	Proportion of Total (%)	Total Volume (m <sup>3</sup> )	Average Daily Flow (m <sup>3</sup> /day)	Proportion of Total (%)
Jan	18,614	600	76%	5,879	190	27%
Feb	16,904	604	82%	3,748	134	18%
Mar	18,034	601	82%	4,037	130	17%
Apr	16,961	565	80%	4,176	139	19%
May	18,874	609	77%	5,655	189	24%
Jun	17,052	568	76%	5,375	179	22%
Jul	19,129	617	80%	4,804	155	20%
Aug	16,244	524	79%	4,330	140	18%
Sep	13,542	451	77%	3,966	132	18%
Oct	14,778	477	77%	4,302	139	20%
Nov	14,457	482	72%	5,703	190	27%
Dec	13,960	465	69%	6,343	211	27%
Total	198,549	---	---	58,318	---	---
Average	16,546	544	77%	4,860	160	23%

### 4.3 Recent Historical Flows

Table 17 summarizes recent historical flow monitoring results for the BCMI DWS. There was a significant decrease in the volume of treated water supplied in 2025 when compared to the previous 15 years. This is likely attributed to the substantial repairs and improvement of the distribution system. Total annual volumes of treated water supplied in the upcoming year may be expected to be between 300,000 m<sup>3</sup> and 450,000 m<sup>3</sup>, which represents approximately 14% to 20% of the rated capacity of the Cochenour Water Treatment Plant.

**Table 17:** Recent historical water production summary

Year	Total Volumes (m <sup>3</sup> )		Daily Flows (m <sup>3</sup> /day)		Annual % Change	
	Raw Water	Treated Water	Average – Treated Water	Maximum – Treated Water	Raw Water	Treated Water
2009	481,351	406,151	1,113	2,007	-13.8%	-9.3%
2010	515,274	424,549	1,163	2,232	+7.0%	+4.5%
2011	471,032	409,384	1,122	2,240	-8.6%	-3.6%
2012	439,530	389,828	1,065	2,007	-6.7%	-4.8%
2013	443,266	408,492	1,119	2,369	+0.8%	+4.8%
2014	412,234	360,120	987	2,061	-7.0%	-11.8%
2015	439,868	390,982	1,071	1,878	+6.7%	+8.6%
2016	419,949	337,245	921	1,557	-4.5%	-13.7%
2017	436,670	341,391	935	2,015	+4.0%	+1.2%
2018	425,326	358,995	984	1,947	-2.6%	+5.2%
2019	422,149	363,215	995	1,874	-0.7%	+1.2%
2020	473,891	386,712	1,057	2,009	+12.3%	+6.5%
2021	477,708	419,903	1,150	2,213	+0.8%	+8.6%
2022	438,660	376,897	1,033	2,201	-8.2%	-10.2%
2023	437,184	376,383	1,031	2,773	-0.3%	-0.1%
2024	338,688	280,432	768	1,419	-22.5%	-25.5%
2025	319,266	256,867	706	1,679	-5.7%	-8.4%

## 5 Compliance

### 5.1 Overview

Northern Waterworks Inc. and the Municipality of Red Lake employ an operational strategy that is committed to achieving the following goals:

- Providing a safe and reliable supply of drinking water to the communities of Balmertown, Cochenour & McKenzie Island;
- Meeting or exceeding all applicable legislative and regulatory requirements; and,
- Maintaining and continually improving the operation and maintenance of the system.

The following sections will summarize incidents of adverse water quality and regulatory noncompliance that occurred during the reporting period. NWI is committed to employing timely and effective corrective actions to prevent the recurrence of identified incidents of adverse water quality and noncompliance.

### 5.2 Adverse Water Quality Incidents

In accordance with section 11 (Annual Reports) of O. Reg. 170/03, this Report must summarize any reports made to the Ministry under subsection 18(1) (Duty to report adverse test results) of *the Act* or section 16-4 (Duty to report other observations) of Schedule 16 of O. Reg. 170/03. Additionally, this Report must describe any corrective actions taken under Schedule 17 of O. Reg. 170/03 during the period covered by the report. The zero (0) adverse water quality incidents that occurred during the reporting period are summarized below.

### 5.3 Regulatory Compliance

In accordance with Schedule 22 (Summary Reports for Municipalities) of O. Reg. 170/03, this Report must list any requirements of the *Act*, the regulations, the system's approval, drinking water works permit, municipal drinking water licence, and any orders applicable to the system that were not met at any time during the period covered by the report (i.e., an incident of regulatory noncompliance). Additionally, this Report must specify the duration of the failure and the measures that were taken to correct the failure.

The most recent inspection by Ontario's Ministry of the Environment, Conservation and Parks was conducted on August 12, 2025, and the final report was received on October 7, 2025. The final inspection rating was 100%, and zero (0) incidents of noncompliance were identified